

XXXXXXXXXX16S-ATCC-MSA1003-Revio-ReadSeg - Bio Sample 3

SUCCESSFUL

Copy

Delete

▼ Analysis Overview
Status
Thumbnails
Display All
➤ Read Segmentation
➤ Data

Display All

Status



Analysis ID 109655
From Multi-Job [109653](#)
Status SUCCESSFUL: 4 tasks finished
Created By etseng
Date Created 2023-12-11, 03:00:36 PM
Date Updated 2023-12-11, 03:23:13 PM
Application Read Segmentation
SMRT Link Version 13.0.0.207600

Inputs





Data Type ↑↓	Name ↑↓
BarcodeSet	Barcode Sets: MAS-Seq Adapter v2 (MAS12)
ConsensusReadSet	HiFi Reads: 20231020-4_84028_13.0VnV-MAS-Seq_PE8_24hPE...

Path

/pbi/flash/smrtlink/smrtlink-alpha/smrtlink/userdata/jobs_root/0000/0000109/0000109655

➤ Analysis Parameters

Thumbnails





Read Segmentation


Value	Analysis Metric
1,472,932	Reads
17,549,822	Segmented reads (S-reads)
1,566	Mean length of S-reads


Value	Analysis Metric
97.27 %	Percent of reads with full arrays
11.91	Mean array size (concatenation factor)

Segmentation Statistics

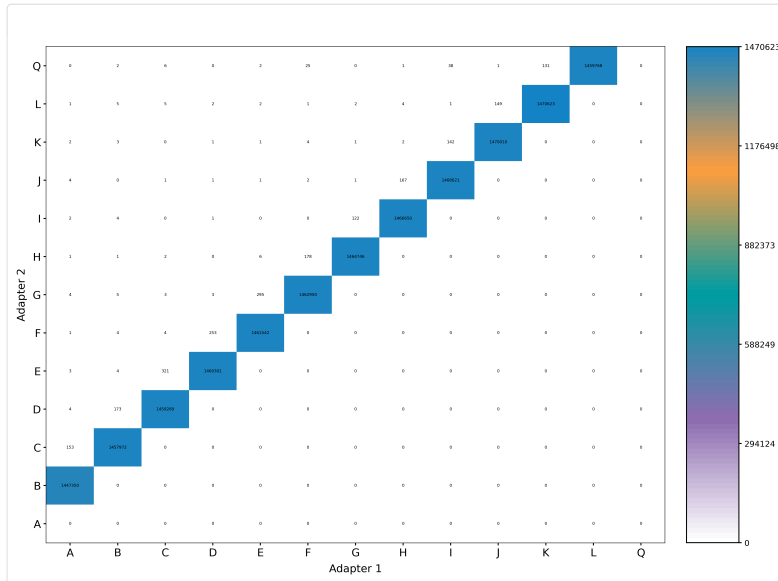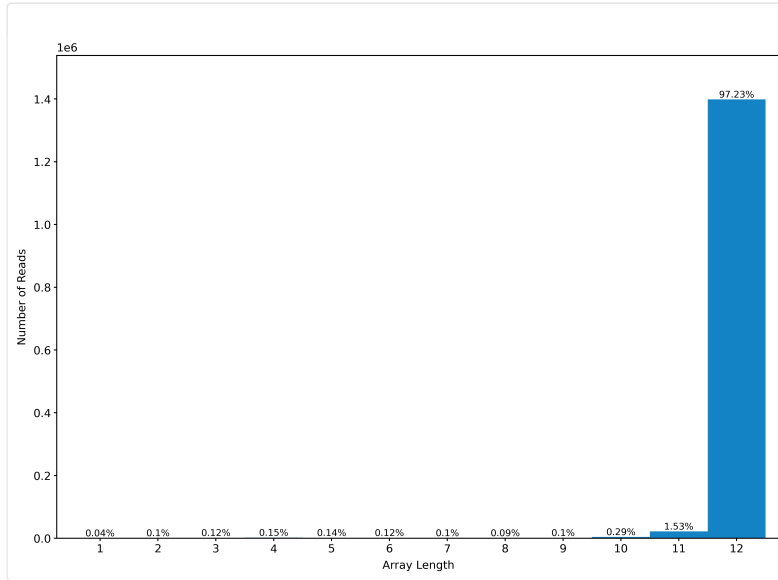


Length of Reads



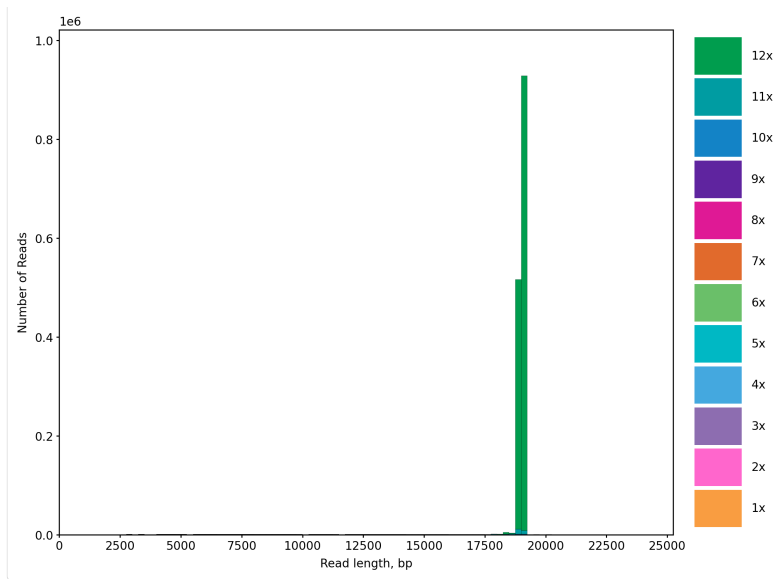

S-read Length Distribution

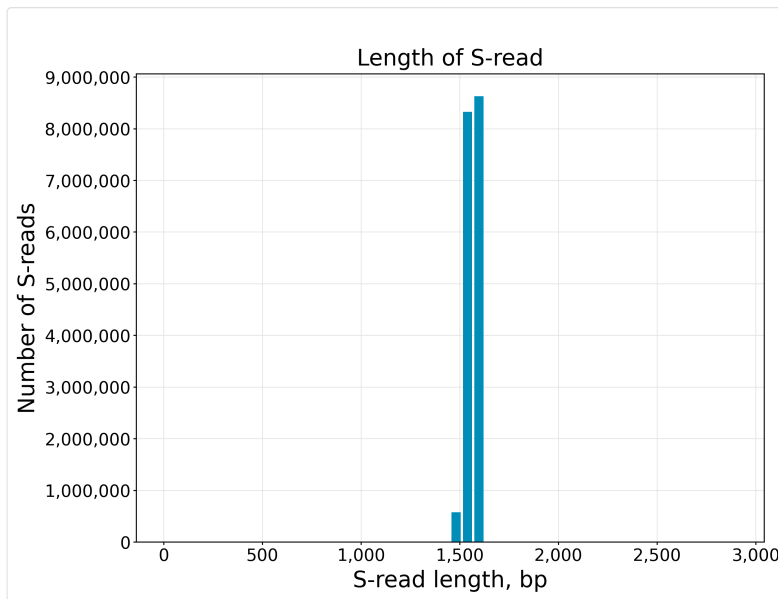

File Downloads

Example:analysis-Bio Sample 3-109655